
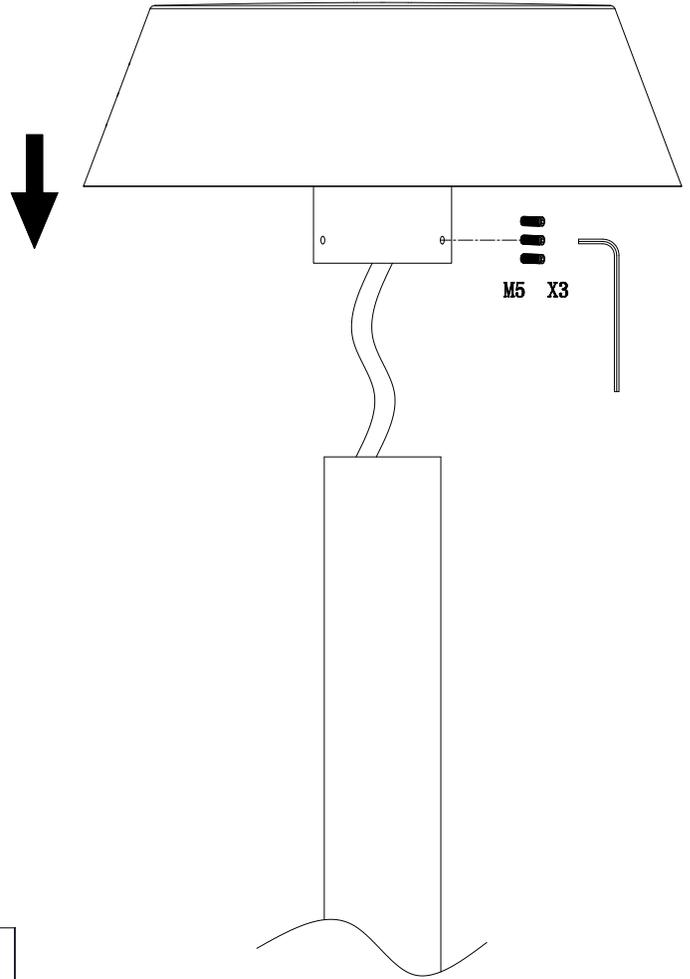


Notes : Do not energize luminaire until installation is completed.
General contractor is responsible for providing appropriate anchoring devices to support load of fixture.


! Risk of fire and electrical shock. Disconnect power at electrical panel before servicing. Fixture must be installed by a qualified electrician only in accordance with national, local building and electrical codes.

- 1 Insert luminaire (A) and adjust direction
- 2 Secure fixture with 3 supplied set screws(3*M5)

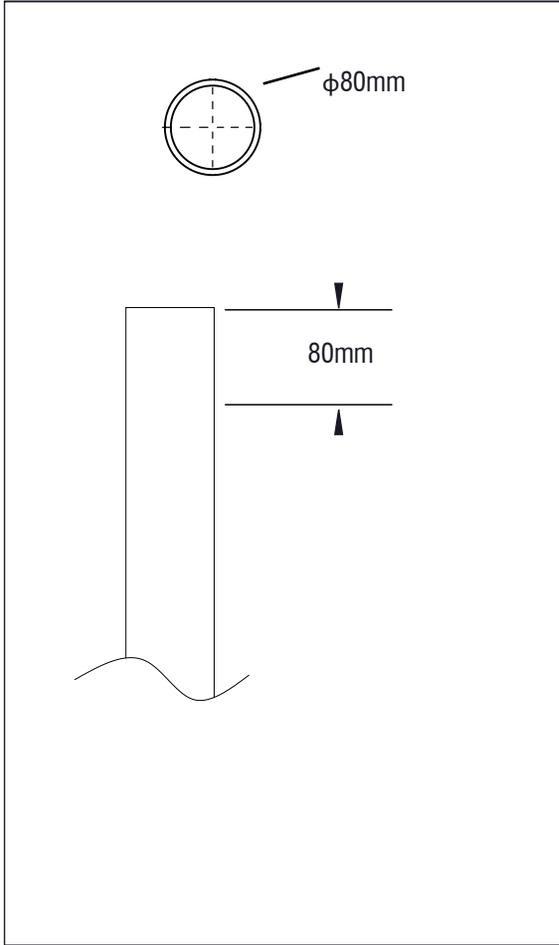

ON-OFF WIRING METHOD:

Universal voltage driver permits operation at 120V through 277V, 50 or 60HZ.

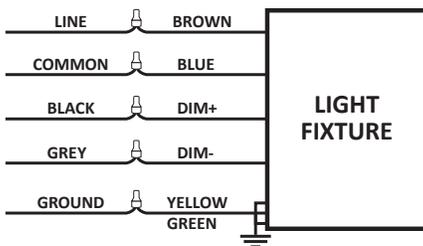

GROUND (YELLOW GREEN)
NEUTRAL (BLUE)
LINE (BROWN)
DIMMING - (GREY)
DIMMING + (BLACK)

